

**Ultra-stable, high precision (ppm class) fluxgate technology DS Series current transducer for non-intrusive, isolated DC and AC current measurement up to 11000A**



### Features

Linearity error maximum 1 ppm

4mm banana jack for secondary current

Transducer core optimized for high level of immunity against external magnetic fields

Operating temperature

Transducer head 0-70°C

Electronics 0-45°C

Turns ratio 1:2500

Aperture diameter 140 mm

2U 19" Control unit with universal (100-240V AC 50/60Hz) AC input voltage or 120-370V DC input voltage

Danisense advanced sensor protection circuit "ASPC"

### Applications:

MPS for particles accelerators

Stable power supplies

Precision drives

Batteries testing and evaluation systems

Power measurement and power analysis

Current calibration purposes

Specification highlights	Symbol	Unit	Min	Typ	Max
Nominal primary AC current	$I_{PN}$ AC	A <sub>rms</sub>			7000
Nominal primary DC current	$I_{PN}$ DC	A	-10000		10000
Measuring range	$\hat{I}_{PM}$	A	-11000		11000
Primary / secondary ratio	$n1 : n2$		1:2500		1:2500
Linearity error	$\epsilon_L$	ppm	-1		1
Offset current (including earth field)	$I_{OE}$	ppm	-5		5
DC-10Hz Overall accuracy @25°C (= $\epsilon_L + I_{OE}$ )	acc $\epsilon$	ppm	-6		6
AC Maximum gain error 10Hz to 1kHz	$\epsilon_G$	%			±0.05
Operating temperature range	Ta	°C	0		70

All ppm (or %) values refer to nominal current


## Electrical specifications at Ta=23°C

Parameter	Symbol	Unit	Min	Typ.	Max	Comment
Nominal primary AC current	$I_{PN\ AC}$	A <sub>rms</sub>			7000	Refer to fig. 1 & 2 for derating
Nominal primary DC current	$I_{PN\ DC}$	A	-10000		10000	Refer to fig. 1 for derating
Measuring range	$I_{PM}$	A	-11000		11000	Refer to fig. 1 & 2 for derating
Overload capacity	$\hat{I}_{OL}$	kA			20	Non-measured, 100ms
Nominal secondary current	$I_{SN}$	mA	-4000		4000	At nominal primary DC current
Primary / secondary ratio			1:2500		1:2500	
Measuring resistance	$R_M$	$\Omega$	0		1	Refer to fig. 1 for details
Linearity error	$\epsilon_L$	ppm $\mu A$	-1 -4		1 4	ppm refers to nominal current $\mu A$ refers to secondary current
Offset current (including earth field)	$I_{OE}$	ppm $\mu A$	-5 -20		5 20	ppm refers to nominal current $\mu A$ refers to secondary current
Offset temperature coefficient	$TC_{IOE}$	ppm/K $\mu A/K$	-0.1 -0.4		0.1 0.4	ppm refers to nominal current $\mu A$ refers to secondary current
Bandwidth	$f(-3dB)$	kHz	100			Small signal, graphs figure 3
Amplitude error 10Hz – 1kHz 1kHz - 5kHz 5kHz - 30kHz	$\epsilon_G$	%			0.05% 1.50% 15.00%	% refers to nominal current
Phase shift 10Hz – 1kHz 1kHz - 5kHz 5kHz - 30kHz	$\theta$	°			0.05° 0.5° 3°	
Response time to a step current $I_{PN}$	$tr @ 90\%$	$\mu s$		1		$di/dt = 100A/\mu s$
Noise 0 - 100Hz 0 - 1kHz 0 - 10kHz 0 - 100kHz	noise	ppm rms			0.05 0.40 3.00 4.00	Measured on secondary current
Fluxgate excitation frequency	$f_{Exc}$	kHz		7.82		
Induced rms voltage on primary conductor		$\mu V_{rms}$			10	
Mains input voltage AC		$V_{AC}$	90		295	50/60 Hz
Mains input voltage DC		$V_{DC}$	127		417	
Control Unit ambient temperature		°C	0		45	
Transducer head temperature		°C	0		70	Refer to fig. 1 for derating
<b>Stability</b>						
Offset stability over time		ppm / month	-0.1 -0.28		0.1 0.28	ppm refers to nominal current $\mu A$ refers to secondary current
Offset change with vertical external magnetic field		$\mu A / mT$			8	(perpendicular to bus bar) $\mu A$ refers to secondary current
Offset change with horizontal external magnetic field		$\mu A / mT$			8	(parallel to bus bar) $\mu A$ refers to secondary current

**Measurement resistor  $R_M$  and ambient temperature derating (Fig. 1)**


**Cable length 5m**

Maximum measurement resistor vs. ambient temperatures

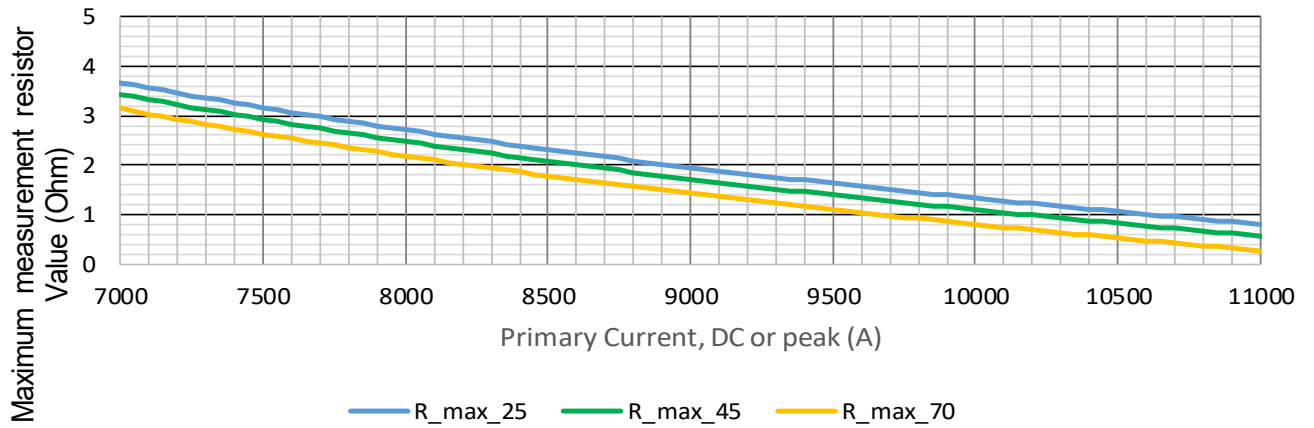


**Frequency and ambient temperature derating (Fig. 2)**

Maximum primary current  $A_{rms}$

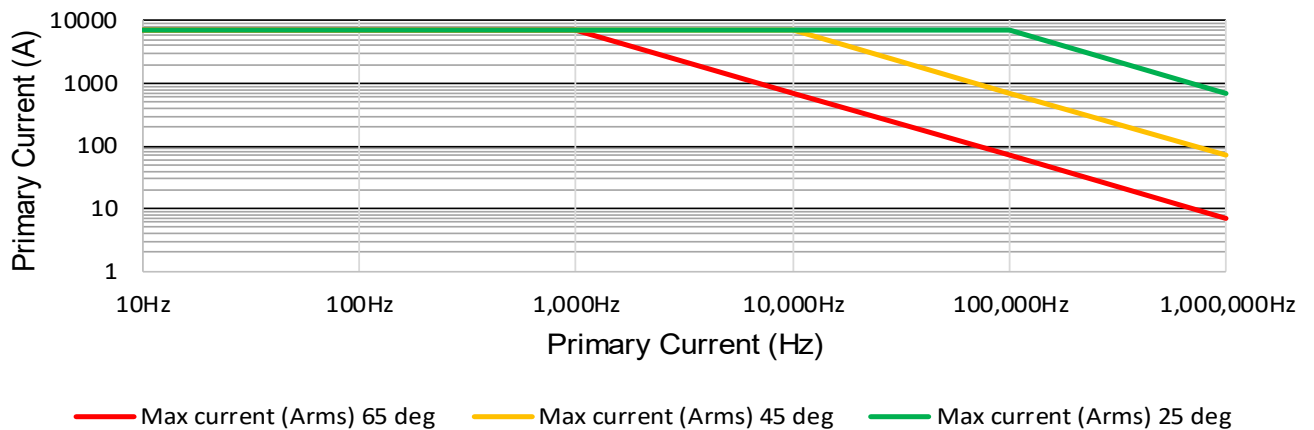

**Frequency characteristics (Fig. 3)**

Amplitude / Phase

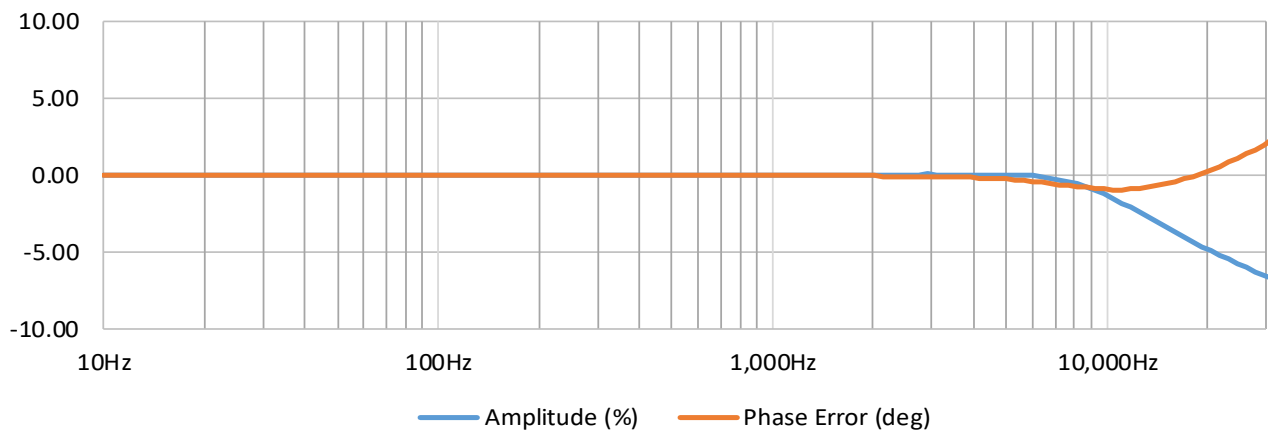

## Isolation specifications

Parameter	Unit	Value
Rated isolation voltage rms, reinforced isolation IEC 61010-1 standard and with following conditions - Overvoltage category III -Pollution degree 2	kV	3
Rms voltage for AC isolation test, 50/60 Hz, 1 min - Between primary and (secondary and shield) - Between secondary and shield	kV	23.7 0.2
Impulse withstand voltage	kV	43.5
Creepage distance / Clearance	mm	60 / 60
Comparative Tracking Index	CTI	600

## Absolute maximum ratings

Parameter	Unit	Max	Comment
Primary current	kA	20	Maximum 100ms
Primary current	kA	11	Continuous

## Environmental and mechanical characteristics

Parameter	Unit	Min	Typ	Max	Comment
Ambient operating temperature range	°C	0		45	Control unit
Ambient operating temperature range	°C	0		70	Transducer head
Storage temperature range	°C	-40		85	
Relative humidity	%	20		80	Non-condensing
Mass	kg		19 6		Transducer Head Control Unit
Connections	4mm banana Jacks				
Standards	EN 61326-1 EMC EN 61010-1:2010 Safety				

**Advanced Sensor Protection Circuits “ASPC”**

Developed to protect the current transducer from typical fault conditions:

- Unit is un-powered and secondary circuit is open or closed
- Unit is powered and secondary circuit is open or interrupted

Both DC and AC primary current up to 100% of nominal value can be applied to the current transducers in the above situations without damage to the electronics.

Please notice that the sensor core can be magnetized in all above cases, leading to a small change in output offset current (less than 10ppm)

DS10000 Transducer Head Dimensions

